



DIRIS A80

Multifunction meters - PMD + RCM

Monitoring energy and fault currents - dimensions 96x96 mm

Single-circuit metering,
measurement &
analysis



DIRIS A80

Function

DIRIS A80 is a complete panel mounted multifunction meter which incorporates RCM current monitoring (Residual Current Monitoring), for networks with TN-S and TT neutral systems, and enhanced data logging functions for recording curves for quality and RCM events. The DIRIS A80 supplies all the measurements required for energy efficiency projects while its RCM function provides preventative earth leakage information, essential in critical applications to avoid installation shutdowns.

Advantages

Compact


The DIRIS A80 combines two complementary products within a single 96 x 96 mm panel mounted case, enabling faster installation and utilising less space. The DIRIS A80 comprises:

- a multifunction meter with enhanced event logging functions which records curves for quality events.
- an RCM fault current monitoring device (Residual Current Monitoring).

Conformity to standard EN 50160

- EN 50160 is a standard which defines events relating to the quality of electrical networks. The DIRIS A80 captures voltage events in accordance with this standard.

Principle diagram

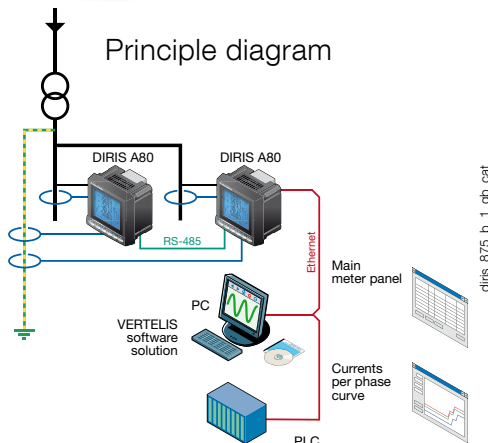

The solution for

- > Industry
- > Infrastructure
- > Health care buildings
- > Data centres

Strong points

- > Compact
- > Patented pending
- > Management softwares
- > Compliant with IEC 61557-12
- > Conformity to standard EN 50160

Conformity to standards

- > IEC 62053-22 class 0.5S
- > IEC 62053-23 class 2
- > IEC 61557-12
- > IEC 62020
- > EN 50160



Patent pending

Automatic adjustment of the leakage current alarm threshold in accordance with the load current to avoid false alarms.

Compliant with IEC 61557-12.

IEC 61557-12 is a high-level standard for all PMDs (Performance Monitoring Devices) that are designed to measure and monitor electrical parameters in distribution networks. Compliance with IEC 61557-12 ensures a high level of equipment performance, in terms of metrology, and the mechanical and environmental aspects (EMC, temperature, etc.).

Management softwares

- Optional Ethernet module with Webserver function: For measurement monitoring, data exploitation and the export of load curves remotely without a specific software (web browser access).
- Analysis software: For the analysis of events data in order to improve the reliability of the electrical installation.
- Easy Config software: For quick and easy remote device configuration; configuration files can be copied from and sent to the DIRIS A80, or they can be created without communication and sent at a later time. Multiple devices can be configured from a single file, which is especially useful for OEMs and panel builders.

Functions

The DIRIS A80 offers the following functions:

- The monitoring of fault currents
- (Residual Current Monitoring)
- Multi-measurement (current, voltage, frequency, power, ...)
- Energy metering
- Harmonic analysis
- Event detection
- Fault currents (RCM)**
 - Measurement of currents $I_{\Delta n}$ ($I_1+I_2+I_3+I_n$) and IPE (protection conductor)
 - Permanent monitoring of $I_{\Delta n}$ and IPE
 - Fault current alarms depending on the load current
 - Record of events $I_{\Delta n}$ and IPE (time, duration and curves stored)
 - Alarm report output

Multi-measurement

- Currents
 - instantaneous: I_1 , I_2 , I_3 , I_n , I_{system} ,
 - average/maximum average: I_1 , I_2 , I_3 , I_n ,
 - unbalance: I_{unb}
- Voltages & frequency
 - instantaneous: V_1 , V_2 , V_3 , U_{12} , U_{23} , U_{31} , F , V_{system} , U_{system}
 - average/maximum average: V_1 , V_2 , V_3 , U_{12} , U_{23} , U_{31} , F
 - unbalance: U_{unb}
- Power
 - instantaneous: $3P$, ΣP , $3Q$, ΣQ , $3S$, ΣS
 - maximum average: ΣP , ΣQ , ΣS
 - predictive: ΣP , ΣQ , ΣS
 - storing of load curves (60 days with an interval of 10 minutes) for the active, reactive and apparent power: $\Sigma P+/-$; $\Sigma Q+/-$; ΣS

- Power factor PF , ΣPF
- Instantaneous total tangent phi
- Instantaneous, average and max. average unbalance
- Metering**
 - Active energy: $\pm$ kWh
 - Reactive energy: $\pm$ kvarh
 - Apparent power: kVAh
 - Hours
- Harmonic analysis (level 63)**
 - Total harmonic distortion
 - Currents: $thd I_1$, $thd I_2$, $thd I_3$, $thd I_n$
 - Phase-to-neutral voltage: $thd V_1$, $thd V_2$, $thd V_3$
 - Phase-to-phase voltage: $thd U_{12}$, $thd U_{23}$, $thd U_{31}$.
 - Individual
 - Currents: HI_1 , HI_2 , HI_3 , HI_n
 - Phase-to-neutral voltage: HV_1 , HV_2 , HV_3
 - Phase-to-phase voltage: HU_{12} , HU_{23} , HU_{31} .

Events

- Alarms on all electrical values
- Detection and storing of the last 60 events:
 - overvoltage
 - voltage dips
 - cut-offs
 - overloads.

For each stored event, the DIRIS A80 records the relevant RMS 10 ms interval curves for the voltages V_1 , V_2 , V_3 , U_{12} , U_{23} , U_{31} , the currents I_1 , I_2 , I_3 and I_n . These curves can be synchronised with the event curves $I_{\Delta n}$ and IPE.

Communications⁽¹⁾

- RS485 MODBUS RTU
- Ethernet (MODBUS TCP or MODBUS RTU over TCP and Webserver)
- Ethernet (MODBUS TCP or MODBUS RTU over TCP and Webserver) with RS485 MODBUS RTU gateway

⁽¹⁾ Available as an option (see the following pages).

Front panel



1. Backlit LCD display.
2. Direct access key for the currents, RCM function and alarm reset.
3. Direct access key for voltages and frequency.
4. Direct access key for active, reactive, and apparent powers and power factor.
5. Direct access key for maximum and average current, voltage and power values.
6. Direct access key for harmonic values and the connection and RCM test functions.
7. Direct access key for energies, hour meter and programming menu.

Accessories

Core balance transformer Δ IC
Please consult us.



Plug-in modules

DIRIS® A80



Communication MODBUS®

- RS485 link with MODBUS® protocol (speed up to 38400 bauds).

Ethernet communication

- Ethernet connection with MODBUS TCP or MODBUS RTU over TCP protocol.
- Embedded Webserver function⁽¹⁾.


Ethernet communication with RS485 MODBUS gateway

- Ethernet connection with MODBUS TCP or MODBUS RTU over TCP protocol.
- Connection of 1 to 247 RS485 MODBUS slaves.
- Embedded Webserver function⁽¹⁾.

⁽¹⁾ See "Management softwares for DIRIS" p. 142.

Terminals

DIRIS A80

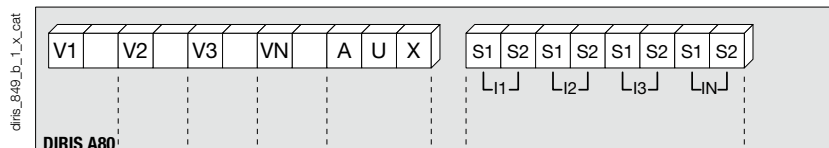


S1 - S2: current inputs

AUX: Auxiliary power supply U_s

V1 - V2 - V3 - VN: voltage inputs

RCM module


1 input / 1 output

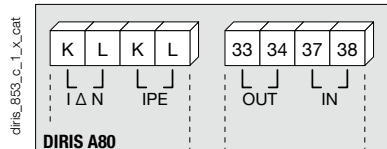

K-L / Δ N: residual current
K-L / IPE: ground fault current
33-34: relay outputs
37-38: opto inputs


RCM module

2 outputs

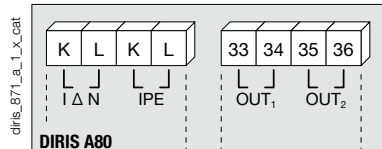


K-L / Δ N: residual current
K-L / IPE: ground fault current
33-34: relay output n°1
35-36: relay output n°2


Memory module



Ethernet module




Ethernet module + RS485 MODBUS gateway

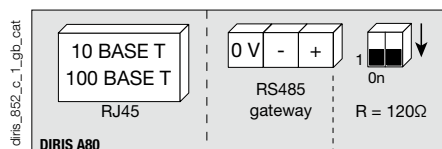

RS485 gateway resistor.

R = 120 Ω : selectable internal resistance for RS485 end of line termination.

RS485 MODBUS module



RS485 link

R = 120 Ω : selectable internal resistance for RS485 end of line termination.

DIRIS A80

Multifunction meters - PMD + RCM


Monitoring energy and fault currents - dimensions 96x96 mm

Connections

Additional information


Communication via RS485 link

diris_398_c_1_x_cat




Connection of voltage transformer for HV networks

diris_399_b_1_x_cat

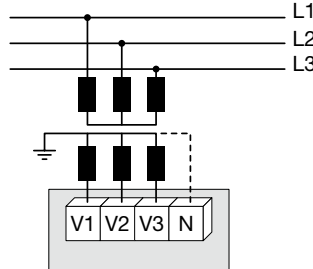

AC & DC auxiliary power supply


diris_400_h_1_gb_cat



1. Fuses 0.5 A gG / 0.5 A class CC.


Three-phase + N network with RCM

diris_873_a_1_gb_cat

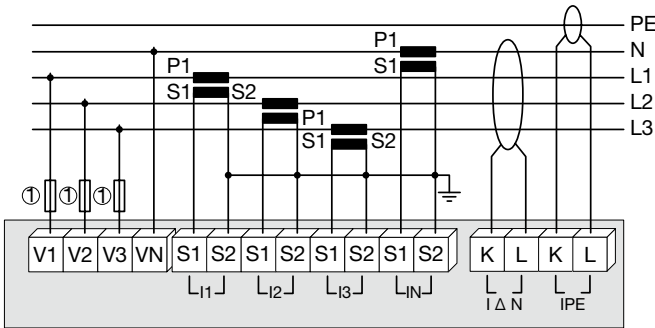

1. Fuses 0.5 A gG / 0.5 A class CC.

Single-phase network with RCM

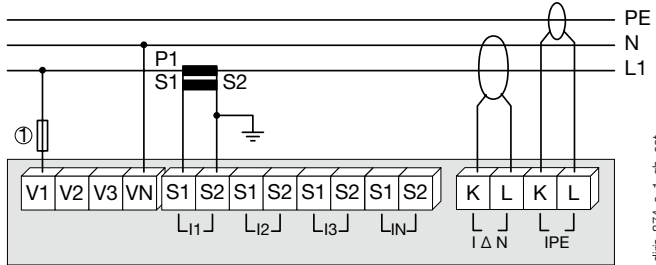

1. Fuses 0.5 A gG / 0.5 A class CC.

Electrical characteristics

Current measurement on insulated inputs (TRMS)

Via CT primary	9 999 A
Via CT secondary	1 or 5 A
Measurement range	0 ... 11 kA
Input consumption	≤ 0.1 VA
Measurement updating period	1 s
Accuracy	0.2 %
Permanent overload	6 A
Intermittent overload	10 I _n for 1 s

Voltage measurements (TRMS)

Direct measurement between phases	50 ... 700 VAC
Direct measurement between phase and neutral	28 ... 404 VAC
VT primary	500 000 VAC
VT secondary	60, 100, 110, 173, 190 VAC
Frequency	50 / 60 Hz
Input consumption	≤ 0.1 VA
Measurement updating period	1 s
Accuracy	0.2 %
Permanent overload	800 VAC

Current-voltage product

Limitation for 1A CT	10 000 000
Limitation for 5A CT	10 000 000

Power measurement

Measurement updating period	1 s
Accuracy	0.5 %

Power factor measurement

Measurement updating period	1 s
Accuracy	0.5 %

Frequency measurement

Measurement range	45 ... 65 Hz
Measurement updating period	1 s
Measurement updating period	0.1 %

Energy accuracy

Active (according to IEC 62053-22)	Class 0.5 S
Reactive (according to IEC 62053-23)	Class 2

Operating conditions

Operating temperature	- 10 ... + 55 °C
Storage temperature	- 20 ... + 85 °C
Relative humidity	95 %

Auxiliary power supply

Alternating voltage	110 ... 400 VAC
AC tolerance	± 10 %
Direct voltage	120 ... 350 VDC
DC tolerance	± 20 %
Frequency	50 / 60 Hz
Consumption	≤ 10 VA

MODBUS communication module

Link	RS485
Type	2 ... 3 half duplex wires
Protocol	MODBUS® RTU
MODBUS® speed	4800 ... 38400 bauds

Ethernet Communication Module

Connection	RJ45
Speed	10 base T / 100 base T
Protocol	MODBUS TCP or MODBUS RTU over TCP

Fault current monitoring characteristics (I_{Δn} and I_{PE})

Inputs I _{Δn} and I _{PE}	
Number of inputs	2
Dedicated core balance transformers	range ΔI _C – transformer ratio 600/1
Measurement of fault current I _{Δn} / I _{PE}	6 mA ... 30 A
Accuracy	1 %

Alarms I_{Δn} and I_{PE}

Thresholds	adjustment depending on the load currents
Time setting	0 to 10 s
Logging	values, dates, durations and curves
Number of events	max. 1000 events


Optocoupler input

Number	specific to the reference
Power supply	5...24 VDC
Minimum signal width	10 ms
Minimum duration between 2 pulses	20 ms
Type	optocoupler

Alarm outputs

Number of relays	specific to the reference
Type	230 VAC – 1 A
Max. N° of operations	10 ⁴

Case

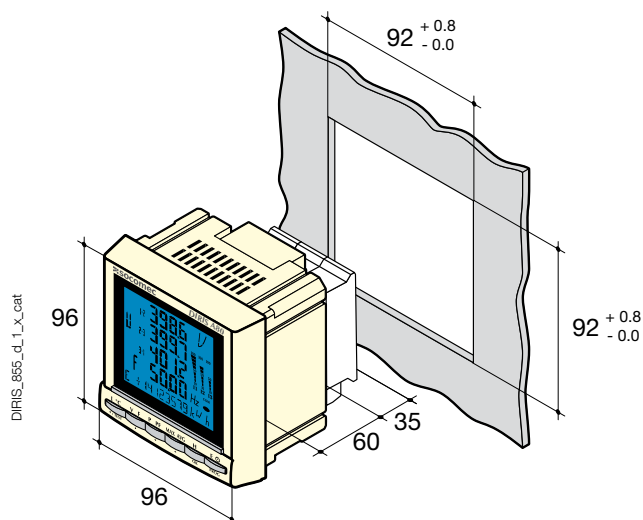

Type	panel mounting
Dimensions W x H x D	96 x 96 x 95 mm
Case degree of protection	IP30
Front degree of protection	IP52
Display type	backlit LCD display
Terminal blocks type	fixed or plug-in
Current connection cross-section	0.5 ... 6 mm ²
Cable cross-section for currents I_{In} and I_{PE}	0.14 ... 1.5 mm ²
Voltage and other connection cross-section	0.2 ... 2.5 mm ²
Weight	560 g

References

Basic device	DIRIS A80
Type	Reference
With 2 outputs	4825 0213
With 1 input / 1 output	4825 0214
Options	
Plug-in modules	Reference
RS485 MODBUS® communication	4825 0092
Ethernet communication (embedded Ethernet Webserver) ⁽¹⁾	4825 0203
Ethernet communication + RS485 MODBUS gateway (embedded Ethernet Webserver) ⁽¹⁾	4825 0204

(1) *Dimensions*: 2 slots.

Accessories		
Description of accessories	To be ordered in multiples of	Reference
IP65 protection	1	4825 0089
Panel mounting kit for a 144 x 96 mm cut-out	1	4825 0088
Fuse disconnect switches for the protection of voltage inputs (type RM) 3 poles	4	5601 0018
Fuse disconnect switches for the protection of the auxiliary supply (type RM) 1 pole + neutral	6	5601 0017
Fuses type gG 10x38 0.5 A	10	6012 0000
Ferrite to be associated with communication modules	1	4899 0011
Current transformer range	1	See page 98

Core balance transformer Δ IC		
Type	Toroid diameter (mm)	Reference
Δ IC Ø15	15	4950 6015
Δ IC Ø30	30	4950 6030
Δ IC Ø50	50	4950 6050
Δ IC Ø80	80	4950 6080
Δ IC Ø120	120	4950 6120
Δ IC Ø200	200	4950 6200
Δ IC Ø300	300	4950 6300
Management softwares for DIRIS		See page 142

Services & Technical Assistance

- Technical site audits and solution specification, commissioning, maintenance, training... Our Services & Technical Assistance experts offer you personalised support to ensure success with all your projects.

